


PLAN

NEENAH FROST-PROOF FRAME AND TYPE B COVER OR EQUAL, LETTERED "WATER" WITH 2 CONCEALED PICK HOLES TYPE F. CASTING SHALL BE SIZED LARGE ENOUGH TO REMOVE METER ASSEMBLY WITHOUT DISASSEMBLING.

TREATED 8' - 4"X4" POST TO MOUNT REMOTE READ ON.
EXISTING GROUND

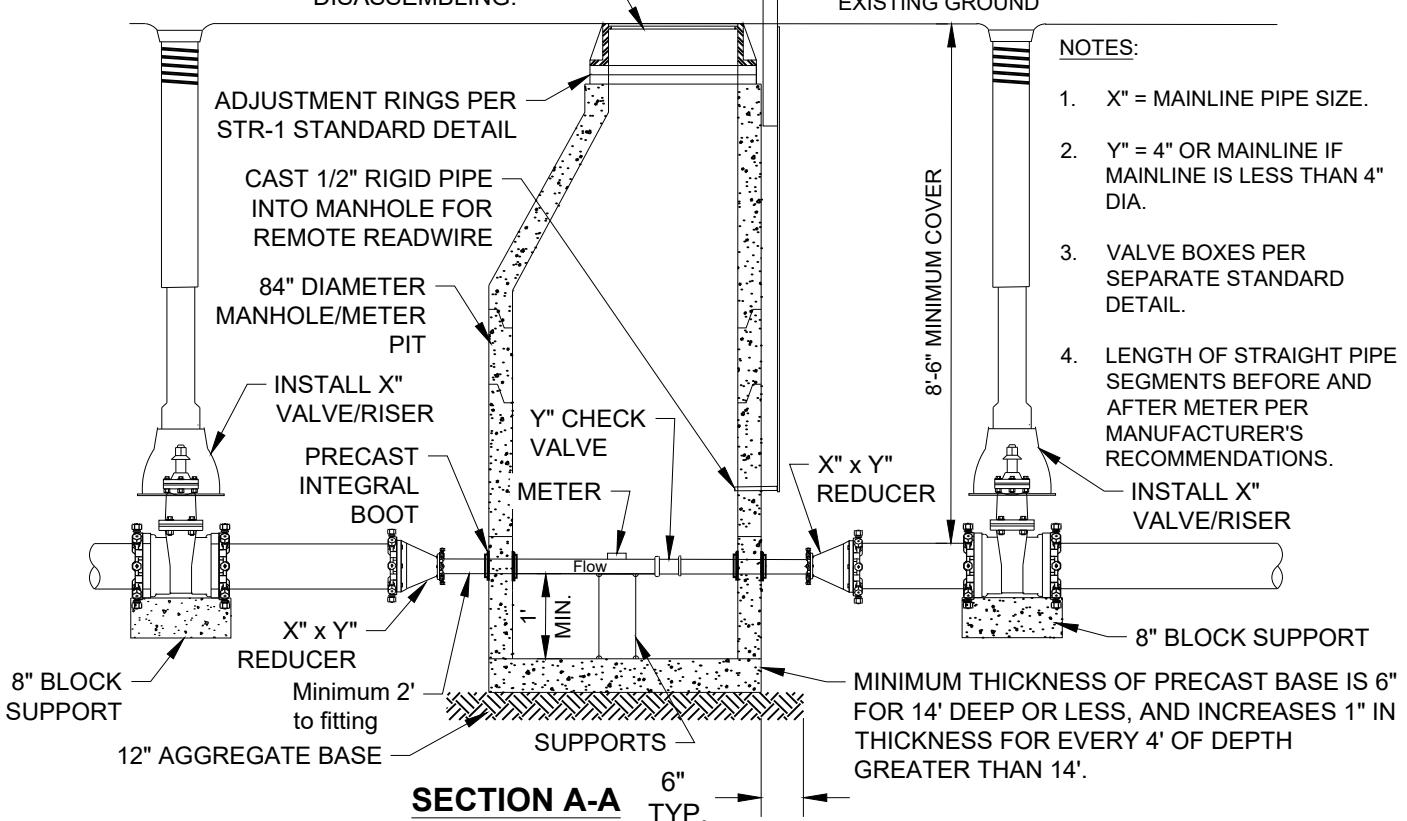

NOTES:

1. X" = MAINLINE PIPE SIZE.
2. Y" = 4" OR MAINLINE IF MAINLINE IS LESS THAN 4" DIA.
3. VALVE BOXES PER SEPARATE STANDARD DETAIL.
4. LENGTH OF STRAIGHT PIPE SEGMENTS BEFORE AND AFTER METER PER MANUFACTURER'S RECOMMENDATIONS.

INSTALL X" VALVE/RISER

City Plate No.:

WAT-6A

Last Revision:

12/18/2020

Section:

2100

STANDARD DETAILS

METER PIT
UP TO 4"

City of Minot